

Wellington Major Outfalls for MS4 Permit

Structure No. 35

Lat: 26 40'37.06"N

Long: 80 14'4.00"W

(2) 60" CAP- 60 LF each with Slide Gate each

Receiving body of water: C-51 Canal

Pump Station No. 3

Lat: 26 40'50.01"N

Long: 80 15'2.09"W

(2) 54" CSP- 44-LF each with 60,000 GPM Pump each

(1) 72" CAP- 44-LF with Slide Gate

Receiving body of water: C-51 Canal

Pump Station No. 4

Lat: 26 40'53.64"N

Long: 80 17'2.56"W

(2) 54" CSP- 40-LF each with 60,000 GPM Pump each

(1) 72" CAP- 40-LF with Slide Gate

Receiving body of water: C-51 Canal

Pump Station No. 6

Lat: 26 40'45.97"N

Long: 80 13'6.18"W

(2) 54" CSP- 40-LF each with 60,000 GPM Pump each

Receiving body of water: C-51 Canal

Pump Station No. 7


Lat: 26 40'55.84"N

Long: 80 17'55.24"W

(3) 48" CSP- 140-LF each with 50,000 GPM pump each

(1) 48" AP- 160LF with Slide Gate

Receiving body of water: C-51 Canal

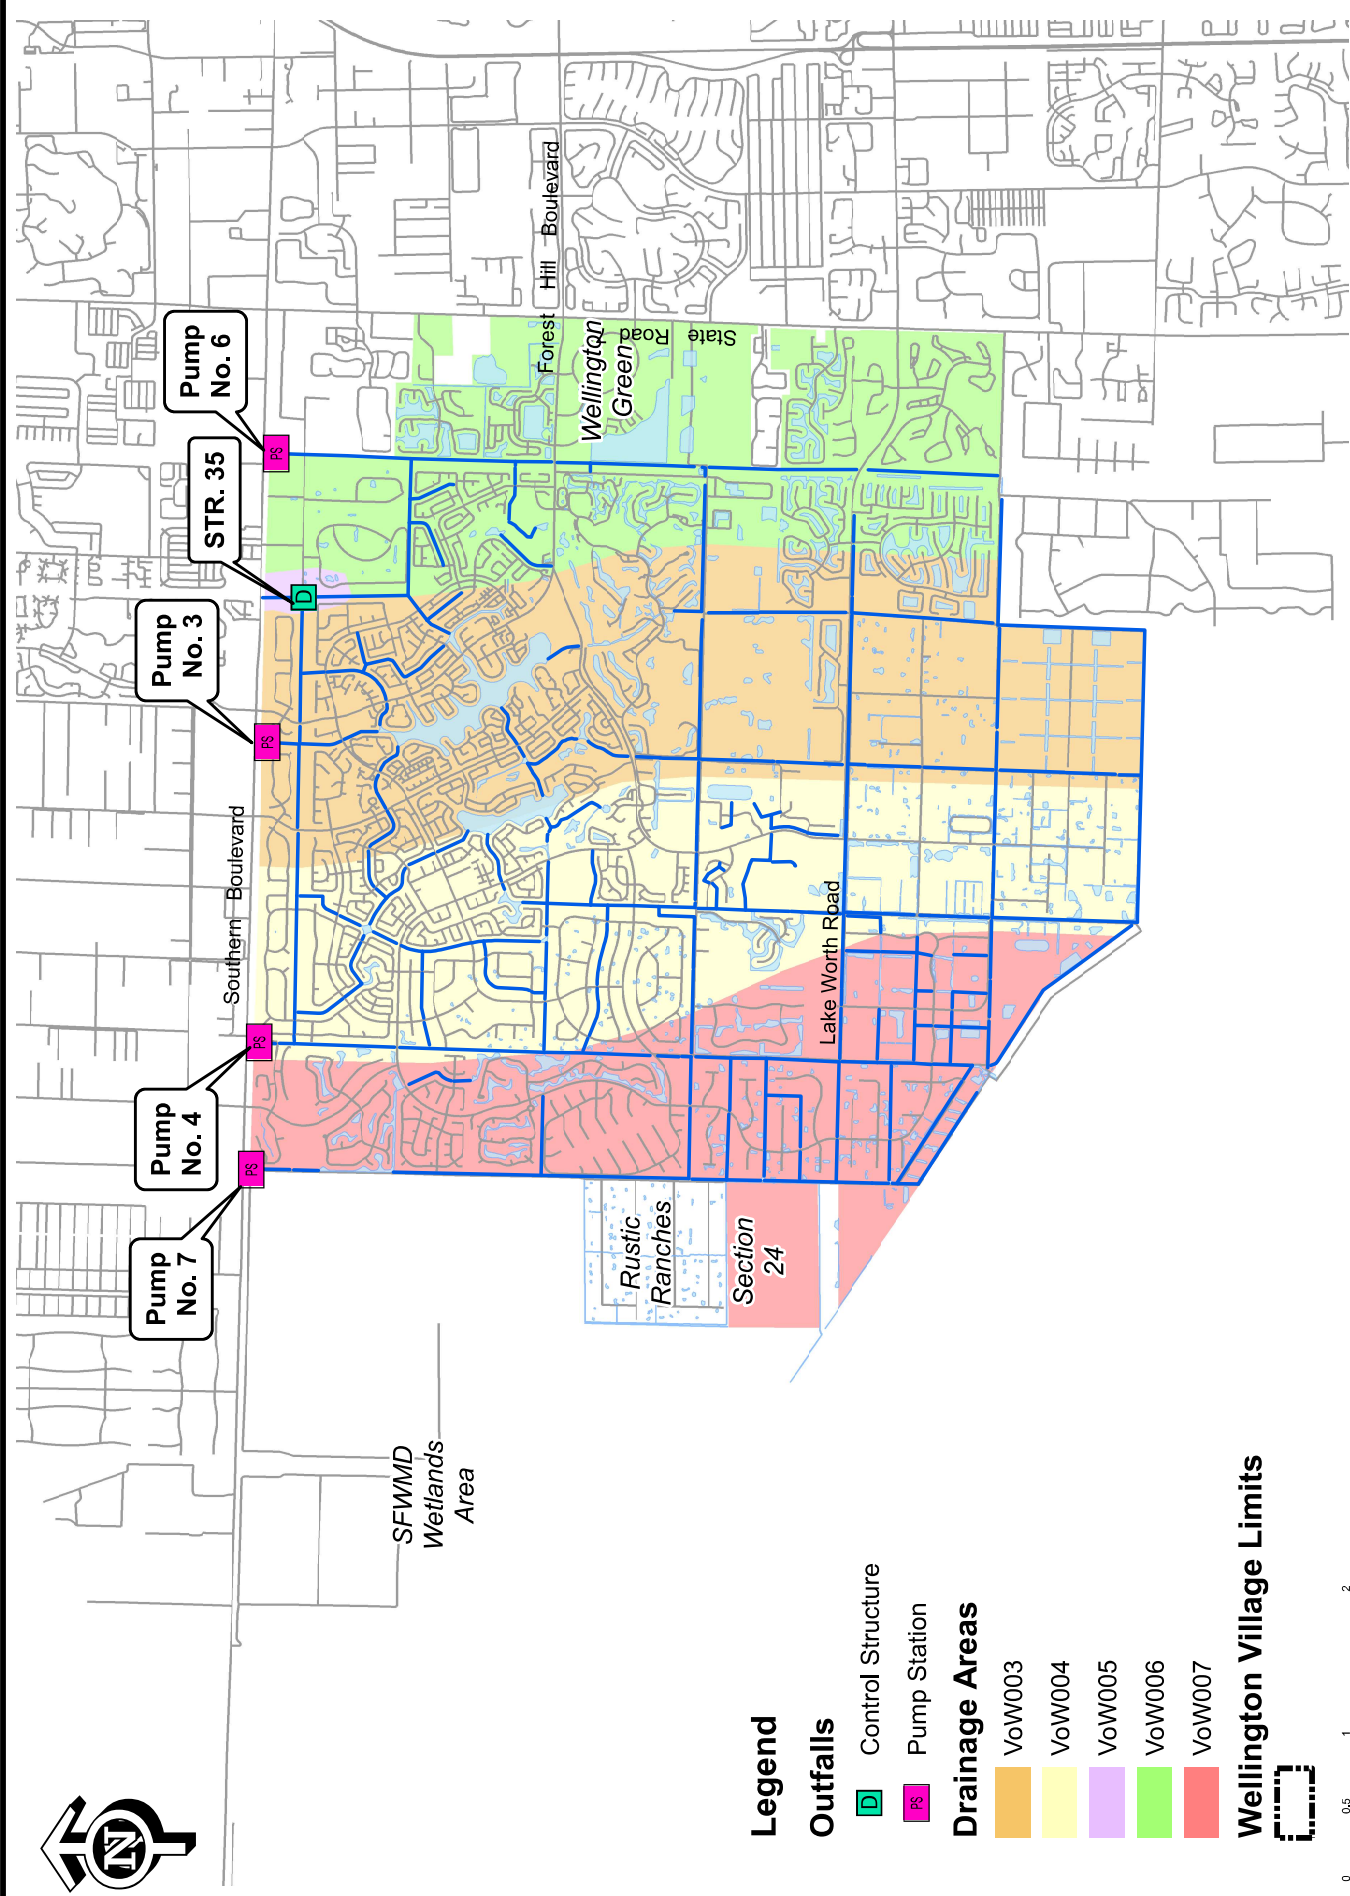

Legend

- Control Structure
- Pump Station

Drainage Areas

- VoW003
- VoW004
- VoW005
- VoW006
- VoW007

Wellington Village Limits



Prepared by:



May 2018



MS4 Outfalls & Associated Drainage Areas
Wellington MS4 NPDES